



TOP VIEW

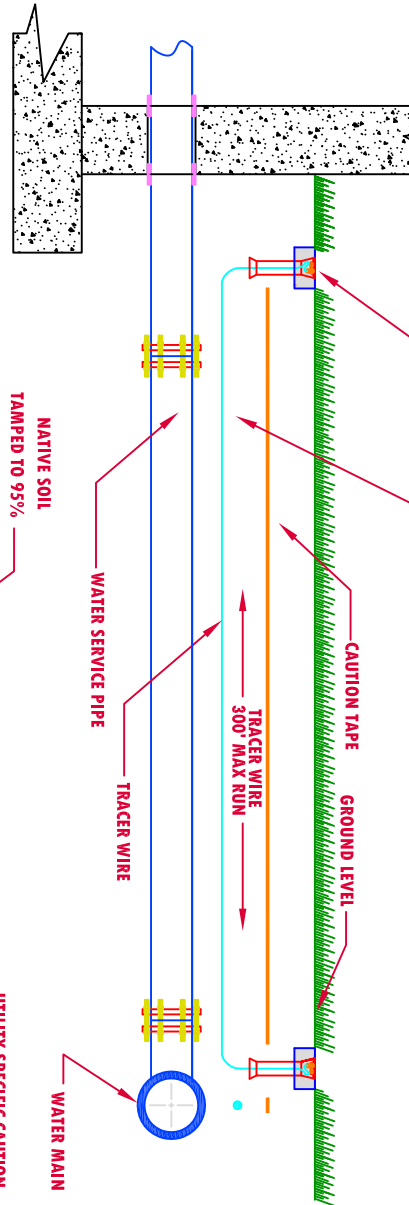

SIDE VIEW

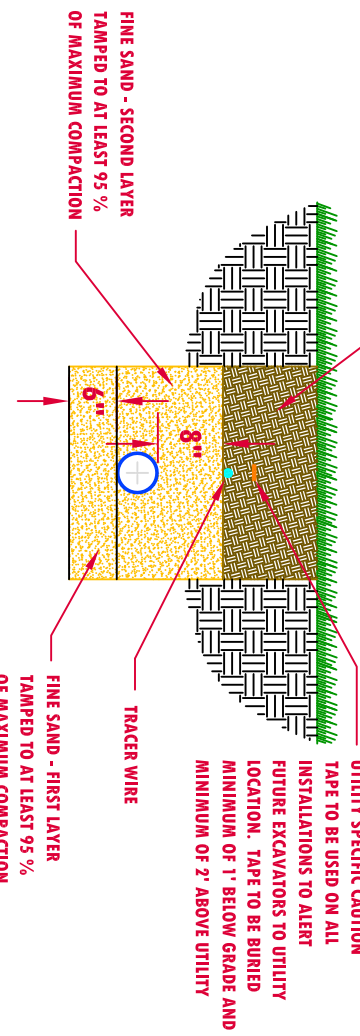

PROFILE

NOTES:
 - TRACER WIRE MUST LAY FLAT AND STRAIGHT. NO COILS MAY BE PRESENT
 - ALL CONNECTIONS MUST BE SOLDERED AND WATERTIGHT

- TAPES MUST NOT BE DAMAGED OR TORN
 - TRACER WIRE RUN MUST NOT EXCEED 300' WITHOUT ADDITIONAL TEST STATION

NOTES:
 - WATER MAINS 3" AND LARGER SHALL BE DUCTILE IRON CEMENT LINED, MECHANICAL JOINT WITH WEDGE ACTION RETAINING GLANDS.
 - ALL FITTINGS SHALL BE MECHANICAL JOINT WITH WEDGE ACTION RETAINING GLANDS

- COVER EXTERIOR PIPES PER FACTORY MUTUAL REQUIREMENTS (OR MINIMUM 3'6")

UTILITY SPECIFIC CAUTION TAPE TO BE USED ON ALL INSTALLATIONS TO ALERT FUTURE EXCAVATORS TO UTILITY LOCATION. TAPE TO BE BURIED MINIMUM OF 1' BELOW GRADE AND MINIMUM OF 2' ABOVE UTILITY

DRAWN BY: TS
 CHECKED BY:
 PROJ #:
 DATE: 04 23 10
 DWG. #

WATER LINE INSTALLATION

